

100(4) Pipe Underdrain Concrete Modular (See Note No. 2) Retaining Wall Geotechnical Fabric Compacted Porous -for ground Granular Preformed Expansion Joint, 20(3/4) stabilization Backfill (CA 16) Gutter or P.C.C. sidewalk Set back according to Manufacturer's Specification Embankment 150 (6) 00.000

LEVELING BASE PAD DETAIL

Compacted Granular Fill (CA 6 or 10)


or 100(4) Non-reinforced Concrete Pad

25(1) Concrete slab

(Required with Graniuar Fill only)

NOTES:

- 1. At the Contractor's option the portion of the stone wall below top of sidewalk elevation may be constructed with class SI concrete. The width shall match the width of the modular block plus the 300(12) maximum trench.
- 2. 100(4) Pipe Underdrains shall outlet into inlets or storm sewer.
- Pipe drains and pipe underdrains shall meet the requirements of the applicable portions of section 601 of the Standard Specifications.
- Preformed expansion joint filler shall be placed between the gutter or sidewalk and the wall.
- 5. The geotechnical fabric shall meet the requirements of the applicable portions of Sections 210 and 1080 of the Standard Specifications.

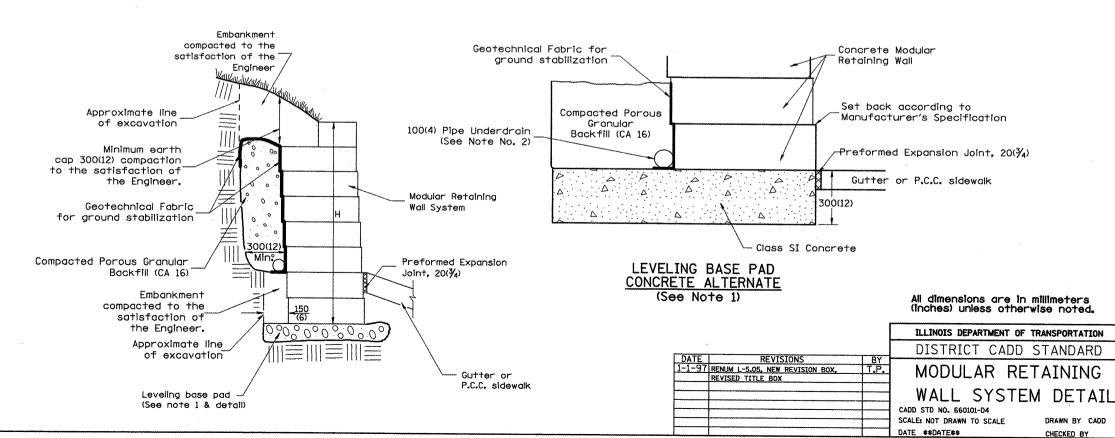

DGN-ONLY

660101-D4